


PLAN VIEW

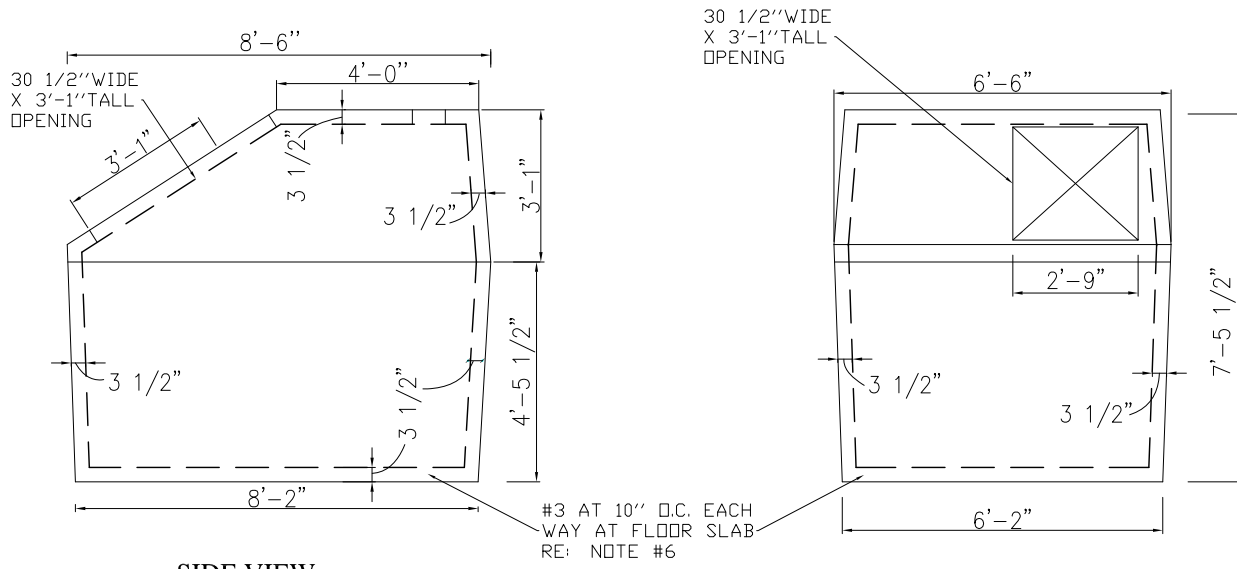

SIDE VIEW

END VIEW

NOTES:

1. CONCRETE THICKNESS SHALL BE AS SHOWN.
2. CONCRETE STRENGTH =6000 PSI. THE WATER-CEMENT RATIO SHALL NOT EXCEED 0.45.
3. REINFORCING SHALL BE GRADE 40 #3 OR #4 BARS AS SHOWN, PLUS FIBERMESH 300 POLYPROPYLENE FIBRILLATED FIBERS FOR SECONDARY REINFORCING.
4. REINFORCING SHALL BE PLACED AT THE CENTER OF SLABS AND WALLS.
5. PROVIDE (1)-#4 BAR 2 INCHES FROM FACE OF ALL OPENINGS. EXTEND 12 INCHES PAST OPENING.
6. EXTEND 90 DEGREE BARS (DOWELS) FROM BOTTOM SLAB INTO WALLS. MATCH DOWEL BARS WITH SPACING OF BOTTOM SLAB BARS AND LAP 16 INCHES.
7. THE SHELTER TOP SLAB IS DESIGNED TO SUPPORT A MINIMUM UNIFORM LOAD OF 200 PSF.
8. ALL SOILS ADJACENT TO THE SHELTERS SHALL BE GRADED SITE SOILS, PROPERLY COMPACTED IN UNIFORM LIFTS NOT TO EXCEED 8 INCHES.
9. IF INSTALLATION DEPTH EXCEEDS 3'-9", EXTENDED PERIODS OF HIGH GROUND WATER MAY RESULT IN SLIGHT FLOTATION OF THE SHELTER. IF THIS OCCURS, RESET AFTER SOILS DRY.
10. OPENING FOR DOOR, REFER HAUSNER PRODUCT DRAWINGS FOR MORE INFORMATION. CENTER OPENING WITHIN HEIGHT OF SLOPING PANEL.
11. THE DESIGN OF THE CONCRETE STRUCTURE COMPLIES WITH 2014 FEMA P 320 AND ICC-500 STANDARDS FOR TORNADO SHELTER.
12. LOCATION OF OPENING IS ALLOWED ANYWHERE ON THE SLOPED FRONT AS LONG AS REINFORCEMENT REQUIREMENTS ARE MET AND DOOR HARDWARE DOES NOT INTERFERE.

THIS DOCUMENT IS VALID ONLY FOR THE ADDRESS SHOWN.

PROJECT: **18030.04**
6X8 EASY ENTRY SHELTER

Hausner's Limited
P.O.Box 1307 Durant, OK 74702-1307
Phone: 580-924-6988 Fax: 580-924-6742

ISSUE DATE:
05-09-2018

SHEET NUMBER:
S-01

Coombs Engineering, P.C.
STRUCTURAL ENGINEERS
2000 N. Central Expressway, Suite 108
Plano, Texas 75074 972-423-4444
Reg # F-13205